




Qwik-Switch 30A Relay Receiver Installation

Model: QS-R-S30

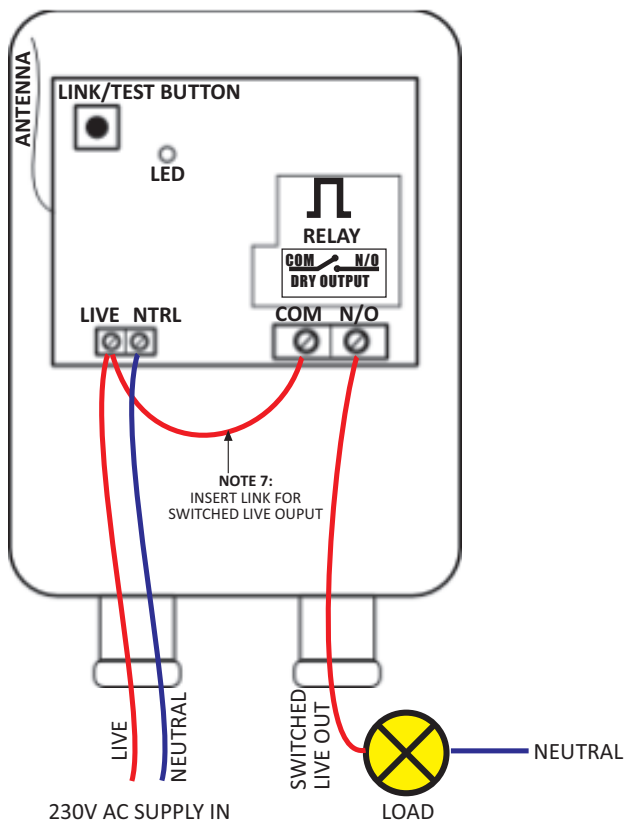

SPECIFICATIONS:

Input supply: 230v AC 50Hz

Splash proof enclosure

LOAD SPECIFICATIONS:

Resistive Load: 5Kw (30A AC) - Halogen bulbs, elements etc.

Inductive: 1Kw (1.5HP) - Motors, Contactors etc. see NOTE 8

LINKING:

1. Hold "LINK/TEST BUTTON" in until "LED" flashes, then release.
2. Press the button on the transmitter....done
3. Repeat steps 1 & 2 for each additional transmitter button required to be linked.

UNLINK:

4. To Unlink a single transmitter button: Repeat steps 1 & 2 of the linking procedure.
5. To clear all links in a receiver: Hold the "LINK/TEST BUTTON" in for approx.10 seconds until the "LED" is ON solid, then release.

NOTES:


6. A receiver can link up to a maximum of 30 different buttons.
7. For a switched LIVE output: Add a link wire from the "LIVE" terminal to the "COM" terminal.
8. For inductive loads a "SNUBBER" might be required, contact QWIKSWITCH for further information.

www.qwikswitch.co.za



Qwik-Switch 30A Relay Receiver Installation

Model: QS-R-S30

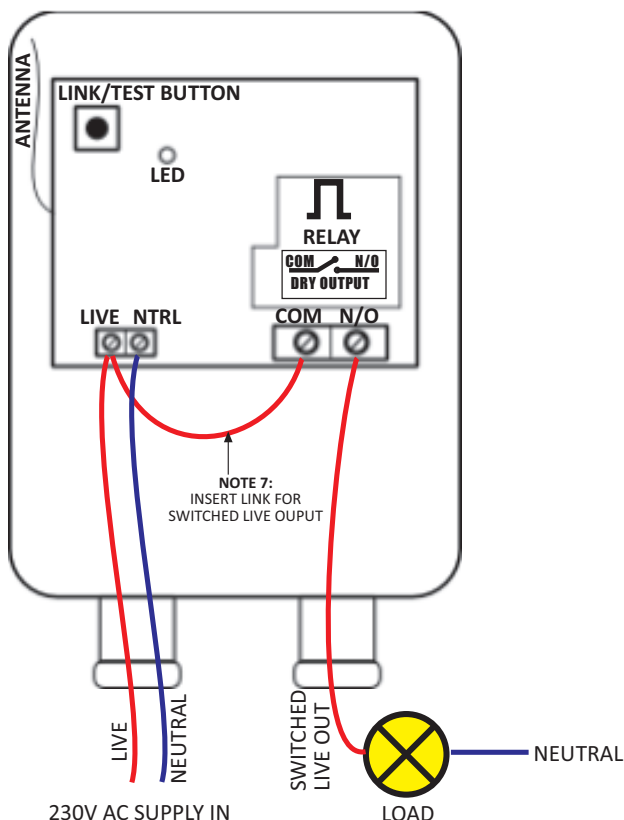

SPECIFICATIONS:

Input supply: 230v AC 50Hz

Splash proof enclosure

LOAD SPECIFICATIONS:

Resistive Load: 5Kw (30A AC) - Halogen bulbs, elements etc.

Inductive: 1Kw (1.5HP) - Motors, Contactors etc. see NOTE 8

LINKING:

1. Hold "LINK/TEST BUTTON" in until "LED" flashes, then release.
2. Press the button on the transmitter....done
3. Repeat steps 1 & 2 for each additional transmitter button required to be linked.

UNLINK:

4. To Unlink a single transmitter button: Repeat steps 1 & 2 of the linking procedure.
5. To clear all links in a receiver: Hold the "LINK/TEST BUTTON" in for approx.10 seconds until the "LED" is ON solid, then release.

NOTES:

6. A receiver can link up to a maximum of 30 different buttons.
7. For a switched LIVE output: Add a link wire from the "LIVE" terminal to the "COM" terminal.
8. For inductive loads a "SNUBBER" might be required, contact QWIKSWITCH for further information.

www.qwikswitch.co.za